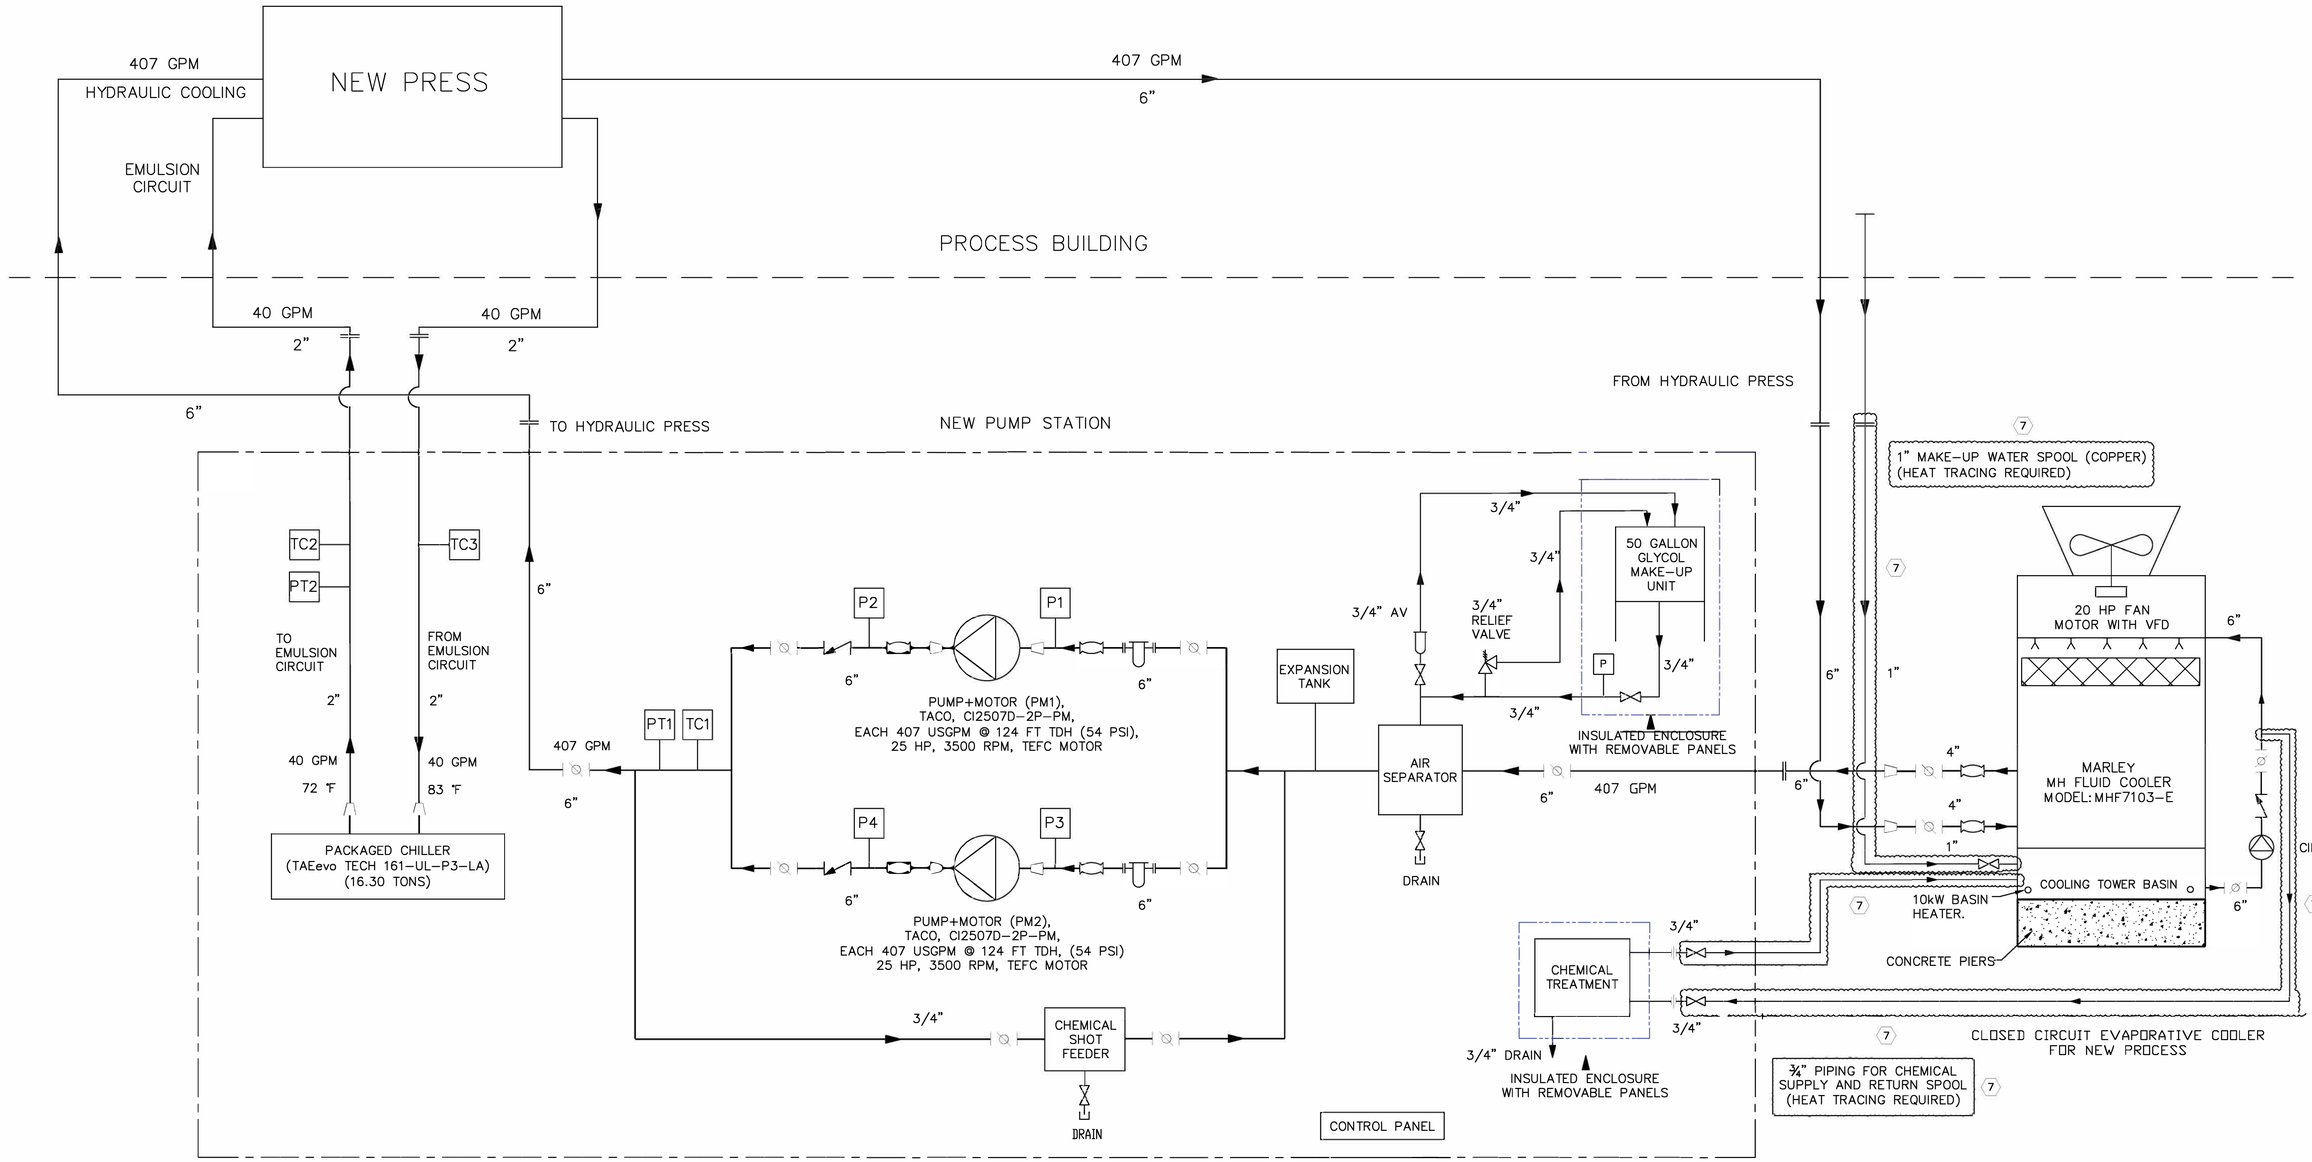


NOTES

P = PRESSURE GAUGE
PT = PRESSURE TRANSDUCER
TC = THERMAL COUPLE
FS = FLOW SWITCH
= RUBBER / STAINLESS FLEX
= CHECK VALVE
= BUTTERFLY VALVE
= GATE / BALL VALVE
= PRESSURE RELIEF VALVE
= PRESSURE REDUCING VALVE
= BASKET STRAINER
= AUTO AIR VENT (AV)
= PIPE REDUCER

⬡ SYMBOL IDENTIFIES REVISION. REFER TO REV. BLOCK FOR DESCRIPTION OF CHANGE(S).

REV	DATE	DESIGN	ENG CHK	DESCRIPTION
7	10/25/24	VT	BA	HEAT TRACING NOTE IS ADDED
6	09/20/24	VT	BA	PRESSURE SENSOR AND TEMPERATURE SENSORS ARE ADDED
5	08/05/24	VT	BA	MAKE–UP WATER SPOOL OF CLOSED CIRCUIT EVAPORATIVE COOLER IS UPDATED TO 1" FROM 2"
4	07/17/24	VT	BA	MAKE–UP WATER SPOOL IS ADDED TO CLOSED CIRCUIT EVAPORATIVE COOLER
3	06/27/24	VT	BA	REVISION IS INLINE WITH ORTHO DRAWINGS
2	06/19/24	VT	BA	REVISION IS INLINE WITH ORTHO DRAWINGS
1	06/17/24	VT	BA	REVISION IS INLINE WITH ORTHO DRAWINGS
0	06/10/24	VT	BA	APPROVAL

This drawing and data is the property of Fluid Cooling Systems, LLC.
The information contained herein is confidential and proprietary information of Fluid Cooling Systems and is not transferable. This print is furnished with the clear understanding that it is to be used only for repair and maintenance of equipment furnished by Fluid Cooling System, LLC and to assist in obtaining spare parts. It shall not be loaned, copied, or otherwise used in manufacture without the express written permission of Fluid Cooling Systems, LLC.

FLUID COOLING SYSTEMS, LLC.
2441 E. Bristol Rd
Burton, MI. 48529
P: 248.430.6271
www.fluidcoolingsystems.com

DRAWING TITLE: PROCESS & INSTRUMENTATION DIAGRAM (P&ID)
EQUIPMENT: CLOSED LOOP PUMP STATION
SHEET NO.: 1 OF 1
REV.: 7
CUSTOMER:
DRAWING NO.: 230134_PID